


REFERENCE NOTES

1. EXISTING PG&E SUBSURFACE TRANSFORMER, "T-2345".
 2. EXISTING TELEPHONE UTILITY SPLICE BOX.
 3. EXISTING CABLE TV UTILITY PEDESTAL.
 4. SEE SHEET E1.1 FOR CONTINUATION.
 5. NEW UNDERGROUND SERVICES TO NEW BUILDING:
 - (1) 4" PG&E SECONDARY
 - (1) 2" AT&T
 - (1) 2" CHARTER TV.
- REFER TO SHEET E1.1, "PROPOSED UTILITY REROUTING PLAN". VERIFY EXACT REQUIREMENTS WITH EACH UTILITY. REFER TO FLOOR PLAN FOR CONTINUATION OF SERVICES.
6. MOUNT ABOVE COUNTER.
 7. PROVIDE CONNECTION TO WALL HEATER. REFER TO MECHANICAL PLANS.
 8. TO EXISTING PANEL "L1".
 9. EXISTING 200 AMP PANEL "L1". (SEE PANEL SCHEDULE)
 10. PULLBOX INSTALLED FOR TEMPORARY POWER DURING CONSTRUCTION (REFER TO SHEET E1.1). INTERCEPT EXISTING SITE LIGHTING BRANCH CIRCUITS AND EXTEND IN NEW UNDERGROUND CONDUIT TO TIME SWITCH 'TS2' IN ELECTRIC ROOM.
 11. APPROXIMATE LOCATION OF TIME SWITCH 'TS2'. VERIFY LOCATION ON FLOOR PLANS.
 12. PROVIDE CONNECTION TO EXHAUST FAN. INTERLOCK WITH ROOM LIGHT SWITCH. REFER TO MECHANICAL PLANS.

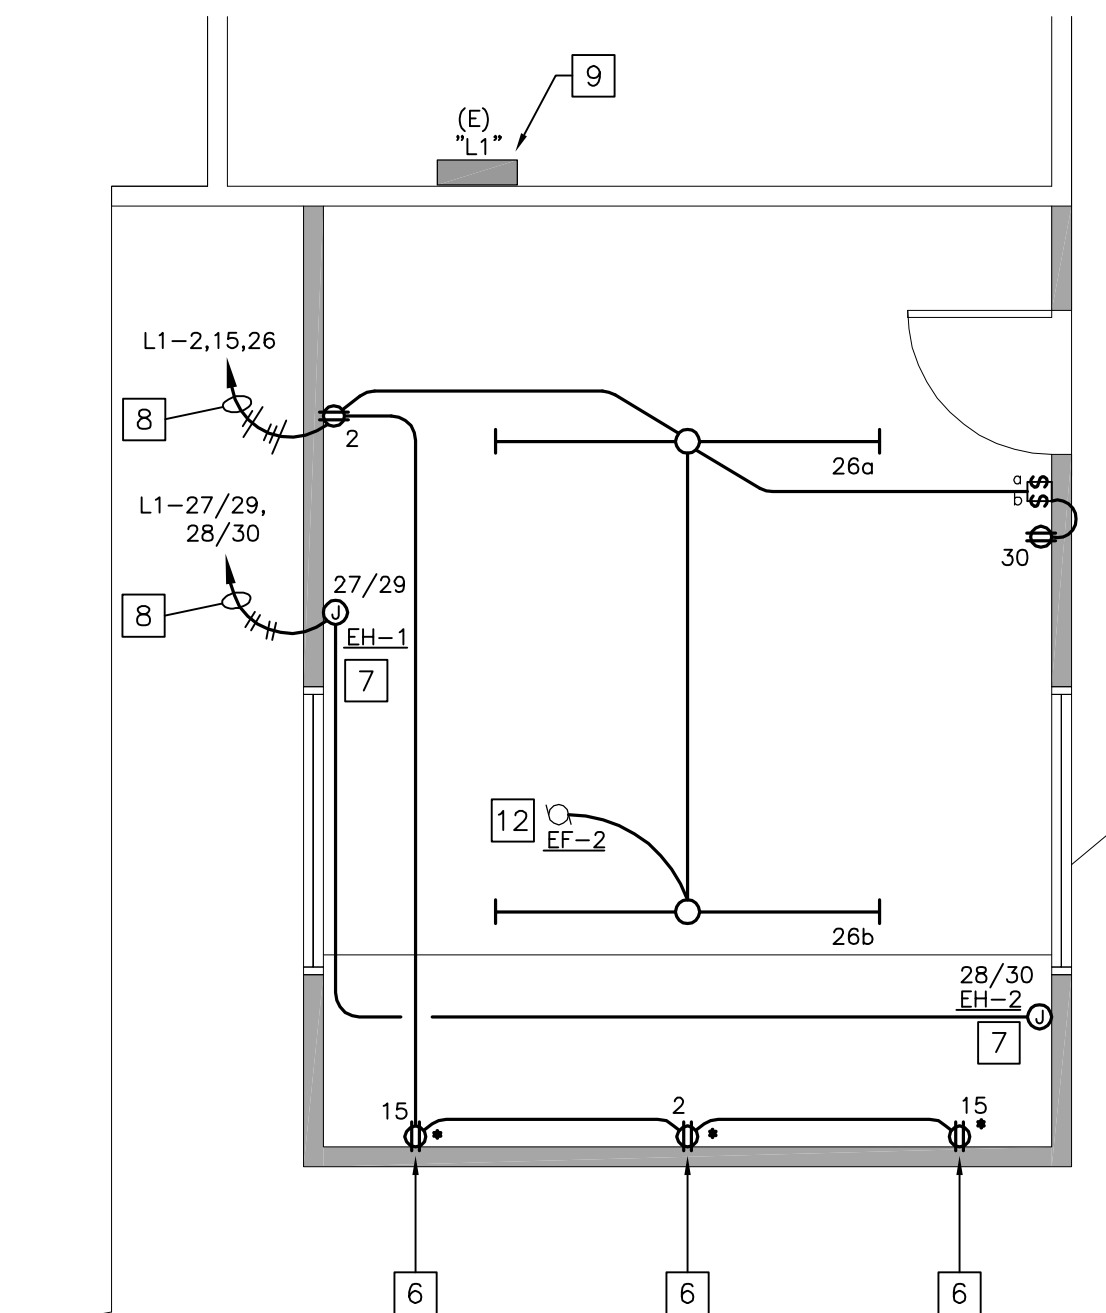

1 FLOOR PLAN - SHOP ADDITION
SCALE: 1/4"=1'-0"

ELECTRICAL SITE PLAN
SCALE: 1"=30'-0"
NORTH

PROJECT

ACCESSIBILITY IMPROVEMENTS

ROLLING HILLS APARTMENTS

TEMPLETON, CA

CLIENT JOB # ARCHITECT JOB #
0708B

FRASER SEIPLE ARCHITECTS

PROJECT MANAGER JT

DRAWN BY DM

DATES FIRST SUBMITTAL 5/28/10
PLAN CHECK 1 8/16/10

SIGNED

Thoma ENGINEERING
THOMA ELECTRIC, INC.
P.O. Box 1167 - 3562 Empire St.
San Luis Obispo, CA 93408
Phone: (805) 543-3850
Fax: (805) 543-3829
cost@thomasec.com

REGISTERED PROFESSIONAL ENGINEER
WILLIAM A. THOMA
NO. 10757
ELECTRICAL
STATE OF CALIFORNIA
EXPIRES: 06/30/11
THOMA #10-8055

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE
ELECTRICAL SITE PLAN AND SHOP ADDITION FLOOR PLAN

SHEET #
E1.0